

投光灯具参数概要:


报告中的参数折算为光源光通为1000lm条件下.

最大光强 (Luminaire orientation as tested.)		176.8 cd/1000lm.
		0.0 度 (垂直)
		0.0 度 (水平)
光束角	10% Imax	180.0V x 180.0H
	50% Imax	180.0V x 180.0H
	90% Imax	180.0V x 180.0H
光束内光通	总计	1000.0 lm/1000lm.
	至 10% Imax	1000.0 lm/1000lm.
	至 50% Imax	1000.0 lm/1000lm.
	至 90% Imax	675.7 lm/1000lm
	上射 LOR	0.0 %
	下射 LOR	100.0 %
灯具效率(光输出比)		100.0 %

H(β) 角度范围:-90度 - 90度	V(B) 角度范围:-90度 - 90度
H(β) 角度间隔: 0.5度	V(B) 角度间隔: 0.5度
测试速度: 快速	测试系统: 远方 (EVERFINE) GO-2000B_V1系统 V2.0.293
环境温度:25.3℃	环境湿度:65.0%
测试人员:	测试距离:6.350米 [K=1.0000]
测试日期:2024-09-27	备注:

灯 具 光 度 数 据

实测参数: U:221.9V I:0.0786A P:5.787W PF:0.3317 实检光通:150.109x1 lm		
灯具名称: 691274-4000K-360-5W	灯具类型:	灯具重量:
灯具规格:	外型尺寸:	测试编号:
制造厂商:	发光口面:	遮光角:

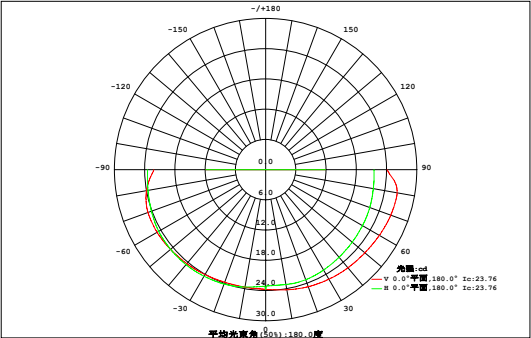

光源数据		光度数据 光效:25.94lm/W	
型号 691274-4000K-360-5W		峰值光强(cd)	26.54
标称功率(W)	5	有效效率(%)	100.0
额定电源电压(V)	220	有效光通(lm)	150.1
额定光通量(lm)	150.109	灯具效率(%)	100.0
灯具内光源数(只)	1	总光通量(lm)	150.1
实测电源电压(V)	220	50%光束角(H,V)	180°,180°

垂 直 角 度 V (°)	区 域 光 通 量																单位:lm		Φ总	Φ有
	0.06	0.17	0.29	0.39	0.47	0.54	0.59	0.63	0.65	0.66	0.65	0.62	0.56	0.49	0.41	0.30	0.19	0.06	7.73	7.73
90	0.06	0.17	0.29	0.39	0.47	0.54	0.59	0.63	0.65	0.66	0.65	0.62	0.56	0.49	0.41	0.30	0.19	0.06	7.73	7.73
80	0.06	0.18	0.30	0.40	0.47	0.54	0.60	0.64	0.66	0.67	0.65	0.62	0.57	0.50	0.41	0.31	0.19	0.06	7.84	7.84
70	0.06	0.18	0.30	0.40	0.48	0.55	0.61	0.65	0.67	0.67	0.66	0.63	0.58	0.51	0.42	0.31	0.19	0.06	7.93	7.93
60	0.06	0.18	0.30	0.40	0.49	0.56	0.61	0.65	0.67	0.68	0.67	0.63	0.58	0.51	0.42	0.31	0.19	0.07	8.02	8.02
50	0.06	0.19	0.31	0.41	0.50	0.57	0.62	0.66	0.68	0.69	0.67	0.64	0.59	0.52	0.43	0.32	0.20	0.07	8.11	8.11
40	0.06	0.19	0.31	0.42	0.51	0.58	0.63	0.67	0.69	0.69	0.68	0.65	0.60	0.52	0.43	0.32	0.20	0.07	8.21	8.21
30	0.06	0.19	0.31	0.42	0.51	0.58	0.64	0.68	0.70	0.70	0.69	0.66	0.60	0.53	0.43	0.33	0.20	0.07	8.30	8.30
	0.06	0.19	0.32	0.43	0.52	0.59	0.64	0.68	0.70	0.71	0.70	0.66	0.61	0.53	0.44	0.33	0.20	0.07	8.37	8.37
	0.06	0.19	0.32	0.43	0.52	0.60	0.65	0.69	0.70	0.70	0.70	0.67	0.62	0.54	0.45	0.33	0.21	0.07	8.46	8.46
	0.06	0.19	0.32	0.43	0.52	0.60	0.65	0.68	0.71	0.72	0.72	0.69	0.63	0.55	0.45	0.34	0.21	0.07	8.53	8.53
	0.06	0.19	0.31	0.42	0.52	0.60	0.66	0.70	0.73	0.73	0.72	0.69	0.63	0.55	0.45	0.34	0.21	0.07	8.59	8.59
-30	0.06	0.19	0.31	0.42	0.52	0.61	0.67	0.71	0.74	0.74	0.73	0.70	0.64	0.55	0.46	0.34	0.21	0.07	8.65	8.65
-40	0.06	0.19	0.30	0.42	0.53	0.61	0.68	0.72	0.74	0.75	0.73	0.70	0.64	0.56	0.46	0.34	0.21	0.07	8.68	8.68
-50	0.06	0.18	0.30	0.42	0.53	0.61	0.68	0.72	0.75	0.75	0.73	0.70	0.64	0.56	0.46	0.34	0.20	0.07	8.70	8.70
-60	0.06	0.18	0.30	0.42	0.53	0.61	0.68	0.72	0.74	0.75	0.73	0.70	0.64	0.56	0.46	0.34	0.20	0.07	8.68	8.68
-70	0.06	0.18	0.30	0.42	0.53	0.61	0.67	0.71	0.74	0.74	0.72	0.69	0.63	0.55	0.45	0.33	0.20	0.07	8.61	8.61
-80	0.06	0.17	0.30	0.41	0.52	0.60	0.66	0.70	0.72	0.73	0.71	0.68	0.62	0.54	0.45	0.33	0.20	0.07	8.45	8.45
-90	0.06	0.16	0.28	0.40	0.50	0.58	0.65	0.69	0.71	0.72	0.70	0.66	0.61	0.53	0.43	0.32	0.19	0.06	8.26	8.26
横 向 角 度 H (°)																				
Φ总	1.08	3.29	5.48	7.47	9.16	10.5	11.6	12.3	12.7	12.8	12.6	12.0	11.0	9.61	7.90	5.87	3.60	1.20	150	---
Φ有	1.08	3.29	5.48	7.47	9.16	10.5	11.6	12.3	12.7	12.8	12.6	12.0	11.0	9.61	7.90	5.87	3.60	1.20	---	150

半边峰角: U:41.0,D:75.0 , L:24.0,R:12.0 NEMA Beam Type: Type 7

H(β)角度范围:-90度 - 90度
H(β)角度间隔: 0.5度
测试速度: 快速
环境温度:25.3℃
测试人员:
测试日期:2024-09-27

V(B)角度范围:-90度 - 90度
V(B)角度间隔: 0.5度
测试系统: 远方(EVERFINE)GO-2000B_V1系统 V2.0.293
环境湿度:65.0%
测试距离:6.350米 [K=1.0000]
备注:

灯 具 等 光 强 曲 线


实测参数: U:221.9V I:0.0786A P:5.787W PF:0.3317 实检光通:150.109x1 lm		
灯具名称: 691274-4000K-360-5W	灯具类型:	灯具重量:
灯具规格:	外型尺寸:	测试编号:
制造厂商:	发光口面:	遮光角:

锥面光通量(90度):

44.073 lm
%lum = 29.4%
%lamp = 29.4%

锥面光通量(120度):

75.545 lm
%lum = 50.3%
%lamp = 50.3%

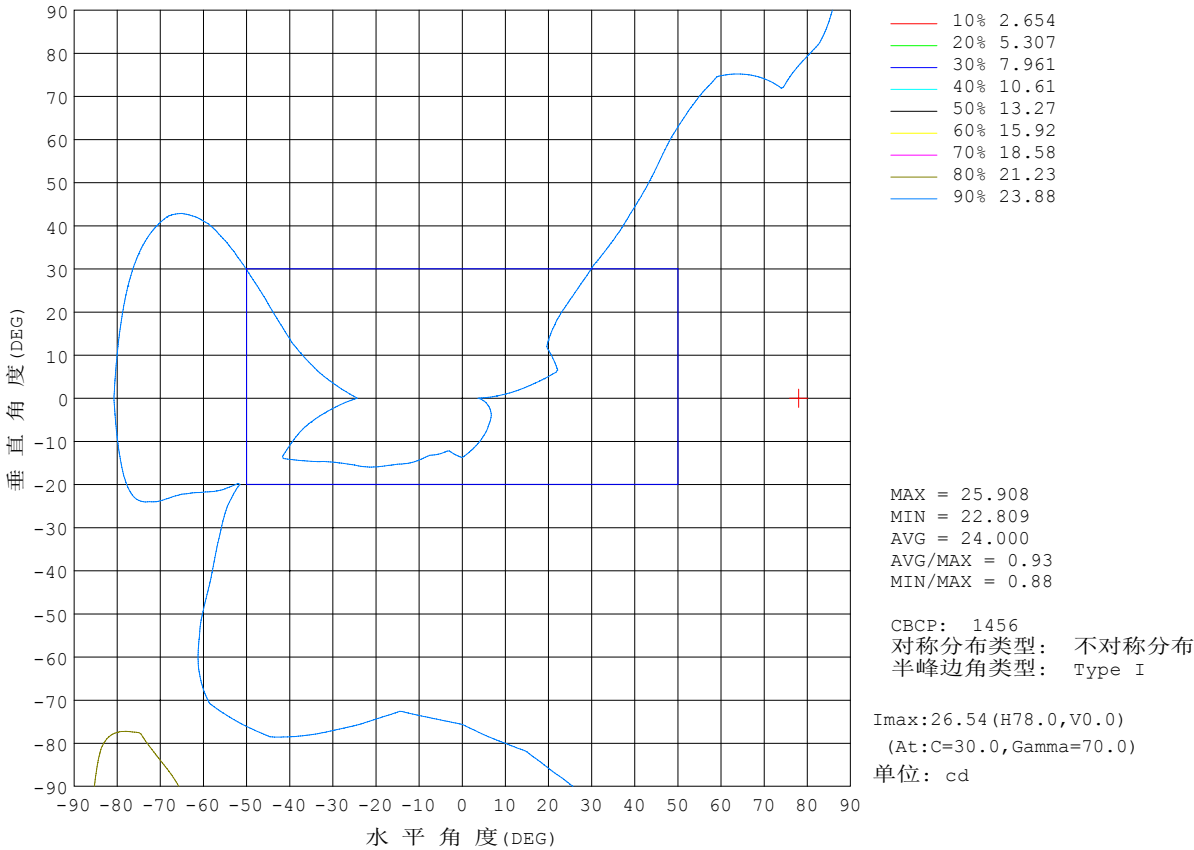


H(β)角度范围:-90度 - 90度
H(β)角度间隔: 0.5度
测试速度: 快速
环境温度: 25.3℃
测试人员:
测试日期: 2024-09-27

V(B)角度范围:-90度 - 90度
V(B)角度间隔: 0.5度
测试系统: 远方(EVERFINE)GO-2000B_V1系统 V2.0.293
环境湿度: 65.0%
测试距离: 6.350米 [K=1.0000]
备注:

平面等照度曲线


实测参数: U:221.9V I:0.0786A P:5.787W PF:0.3317 实检光通:150.109x1 lm		
灯具名称: 691274-4000K-360-5W	灯具类型:	灯具重量:
灯具规格:	外型尺寸:	测试编号:
制造厂商:	发光口面:	遮光角:

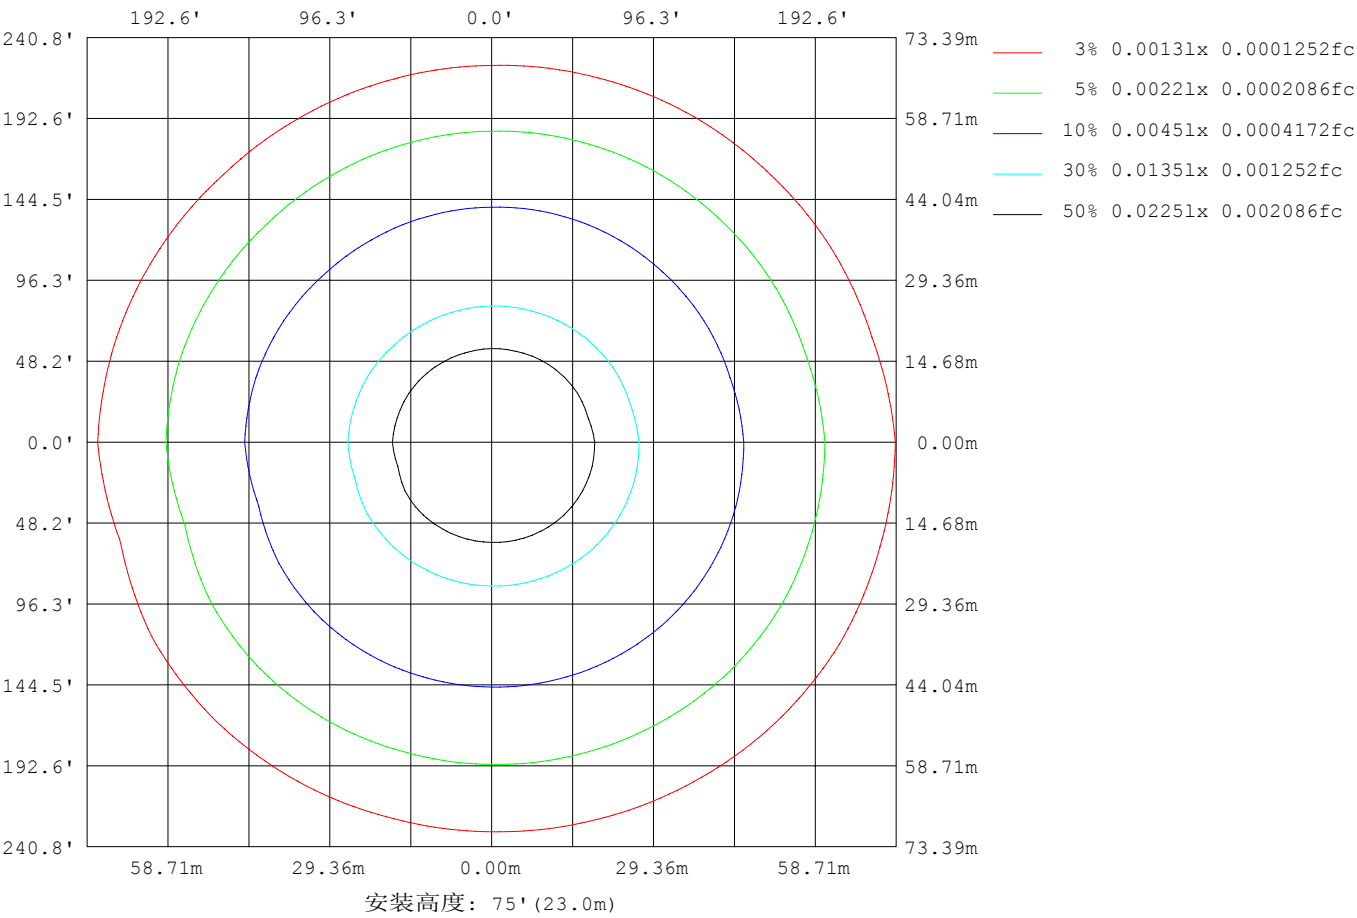

H(β)角度范围:-90度 - 90度
H(β)角度间隔: 0.5度
测试速度: 快速
环境温度:25.3℃
测试人员:
测试日期:2024-09-27

V(B)角度范围:-90度 - 90度
V(B)角度间隔: 0.5度
测试系统: 远方(EVERFINE)GO-2000B_V1系统 V2.0.293
环境湿度:65.0%
测试距离:6.350米 [K=1.0000]
备注:

平面照度曲线

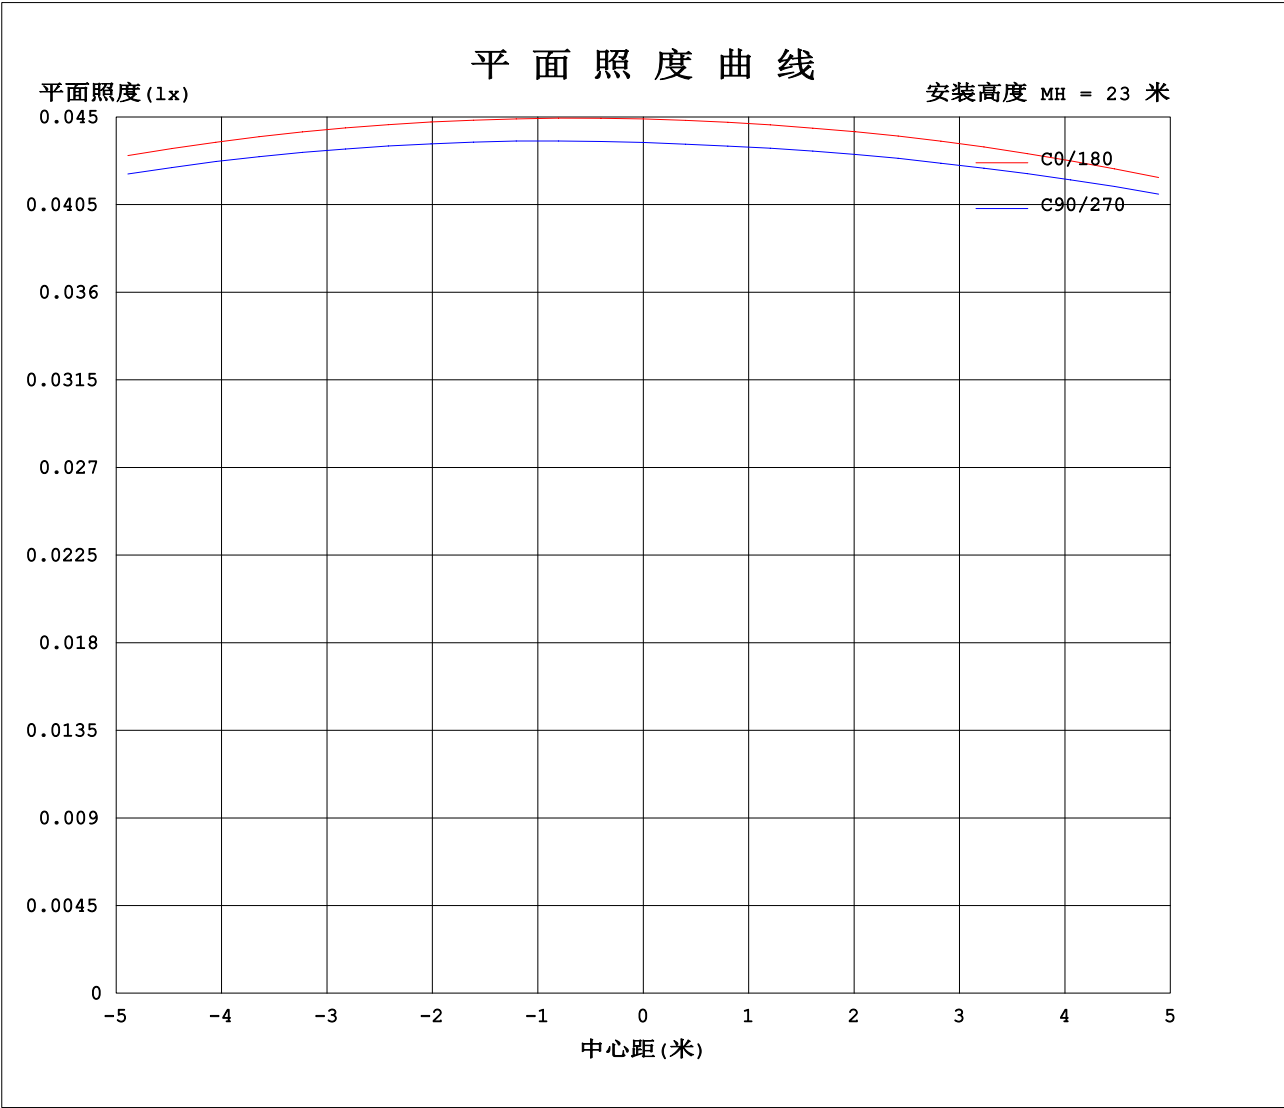


H(β) 角度范围:-90度 - 90度
H(β) 角度间隔: 0.5度
测试速度: 快速
环境温度:25.3℃
测试人员:
测试日期:2024-09-27

V(B) 角度范围:-90度 - 90度
V(B) 角度间隔: 0.5度
测试系统: 远方 (EVERFINE) GO-2000B_V1系统 V2.0.293
环境湿度:65.0%
测试距离:6.350米 [K=1.0000]
备注:

灯 具 有 效 平 均 照 度 图

实测参数: U:221.9V I:0.0786A P:5.787W PF:0.3317 实检光通:150.109x1 lm		
灯具名称: 691274-4000K-360-5W	灯具类型:	灯具重量:
灯具规格:	外型尺寸:	测试编号:
制造厂商:	发光口面:	遮光角:

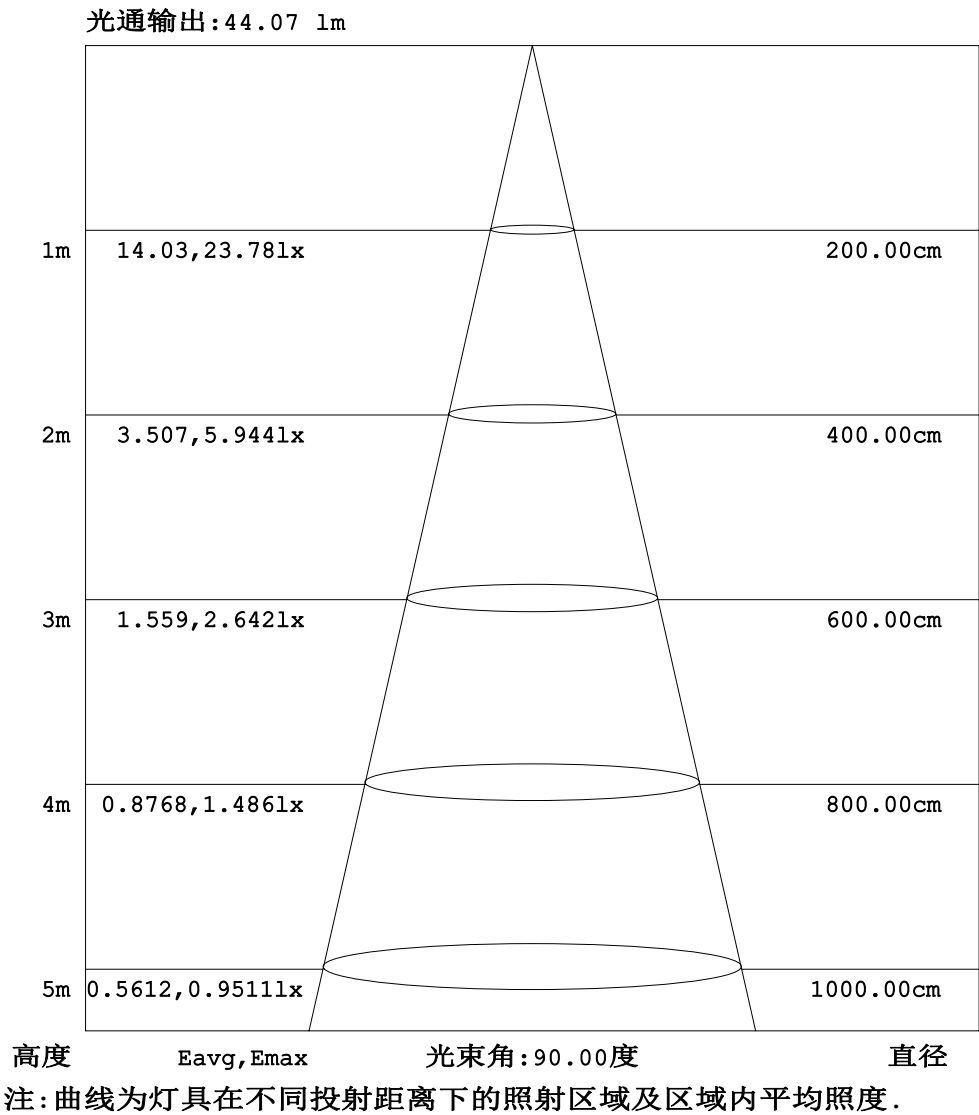

H(β)角度范围:-90度 - 90度
H(β)角度间隔: 0.5度
测试速度: 快速
环境温度:25.3℃
测试人员:
测试日期:2024-09-27

V(B)角度范围:-90度 - 90度
V(B)角度间隔: 0.5度
测试系统: 远方(EVERFINE)GO-2000B_V1系统 V2.0.293
环境湿度:65.0%
测试距离:6.350米 [K=1.0000]
备注:

表--1

光强分布数据表格

单位: cd

H (DEG) V (DEG)	-90	-75	-60	-45	-30	-20	-15	-10	-9	-8	-7	-6	-5	-4	-3
-90		19.10	22.54	22.81	23.14	23.23	23.27	23.33	23.34	23.35	23.36	23.37	23.38	23.39	23.40
-75		21.62	23.56	24.08	23.99	23.86	23.78	23.82	23.83	23.84	23.85	23.86	23.87	23.88	23.88
-60		23.02	24.00	24.49	24.49	24.42	24.40	24.43	24.44	24.45	24.45	24.46	24.47	24.48	24.49
-45		23.39	23.81	24.47	24.57	24.55	24.57	24.59	24.59	24.59	24.60	24.60	24.61	24.61	24.61
-30		23.71	23.60	24.38	24.52	24.44	24.40	24.40	24.40	24.40	24.40	24.41	24.41	24.41	24.41
-20		23.99	23.97	24.10	24.29	24.20	24.18	24.21	24.20	24.20	24.19	24.19	24.19	24.18	24.17
-15		24.14	24.22	23.97	23.90	23.80	23.85	23.94	23.98	24.00	24.00	24.00	24.01	24.03	24.01
-10		24.28	24.44	24.13	23.52	23.39	23.39	23.45	23.48	23.52	23.57	23.62	23.66	23.70	23.75
-9		24.31	24.49	24.17	23.45	23.32	23.30	23.35	23.37	23.41	23.46	23.51	23.57	23.62	23.67
-8		24.34	24.53	24.20	23.50	23.25	23.22	23.27	23.29	23.31	23.36	23.41	23.47	23.53	23.59
-7		24.37	24.57	24.24	23.56	23.18	23.15	23.18	23.21	23.23	23.26	23.31	23.37	23.43	23.50
-6		24.40	24.62	24.27	23.63	23.12	23.08	23.10	23.13	23.15	23.18	23.21	23.26	23.33	23.41
-5		24.43	24.66	24.31	23.70	23.16	23.02	23.04	23.05	23.07	23.10	23.12	23.16	23.23	23.31
-4		24.46	24.71	24.34	23.77	23.27	22.98	22.98	22.98	23.00	23.02	23.04	23.08	23.13	23.20
-3		24.48	24.75	24.38	23.84	23.39	23.15	22.91	22.92	22.93	22.95	22.97	23.00	23.04	23.09
-2.5		24.50	24.77	24.40	23.87	23.46	23.24	22.95	22.89	22.90	22.91	22.93	22.96	23.00	23.05
-2		24.51	24.79	24.41	23.91	23.52	23.33	23.09	23.02	22.93	22.88	22.90	22.92	22.95	23.00
-1.5		24.53	24.81	24.43	23.95	23.58	23.42	23.24	23.18	23.11	23.03	22.92	22.88	22.91	22.95
-1		24.54	24.84	24.45	23.98	23.64	23.52	23.38	23.34	23.30	23.24	23.17	23.07	22.92	22.89
-0.5		24.55	24.86	24.47	24.02	23.71	23.61	23.53	23.51	23.49	23.46	23.42	23.37	23.29	23.17
0	22.20	24.57	24.88	24.49	24.06	23.77	23.70	23.68	23.68	23.68	23.68	23.68	23.68	23.68	23.69
0.5		24.56	24.87	24.47	24.03	23.74	23.66	23.63	23.62	23.62	23.61	23.60	23.59	23.58	23.57
1		24.55	24.86	24.45	24.01	23.71	23.63	23.58	23.57	23.56	23.55	23.53	23.51	23.49	23.45
1.5		24.55	24.85	24.44	23.98	23.68	23.59	23.52	23.51	23.50	23.48	23.46	23.43	23.40	23.35
2		24.54	24.83	24.42	23.96	23.65	23.55	23.47	23.46	23.44	23.42	23.40	23.37	23.32	23.27
2.5		24.53	24.82	24.40	23.93	23.61	23.51	23.42	23.41	23.39	23.37	23.34	23.30	23.26	23.22
3		24.52	24.81	24.39	23.91	23.58	23.48	23.38	23.37	23.34	23.32	23.28	23.24	23.22	23.18
4		24.51	24.79	24.36	23.86	23.52	23.40	23.32	23.29	23.26	23.22	23.20	23.18	23.15	23.10
5		24.49	24.77	24.32	23.81	23.46	23.36	23.26	23.23	23.20	23.17	23.15	23.12	23.09	23.04
6		24.48	24.75	24.29	23.77	23.42	23.32	23.21	23.18	23.16	23.13	23.10	23.08	23.05	23.02
7		24.46	24.73	24.26	23.72	23.40	23.29	23.17	23.15	23.12	23.09	23.08	23.05	23.02	23.01
8		24.44	24.70	24.23	23.68	23.38	23.25	23.14	23.12	23.09	23.08	23.06	23.04	23.02	23.00
9		24.43	24.68	24.20	23.64	23.36	23.22	23.12	23.09	23.08	23.06	23.05	23.03	23.01	22.99
10		24.41	24.66	24.17	23.62	23.34	23.20	23.09	23.08	23.07	23.06	23.04	23.02	23.01	22.99
15		24.31	24.56	24.04	23.52	23.25	23.11	23.06	23.05	23.04	23.04	23.04	23.04	23.03	23.09
20		24.21	24.46	23.92	23.42	23.14	23.08	23.04	23.04	23.04	23.04	23.04	23.05	23.08	23.12
30		23.98	24.25	23.69	23.15	22.93	22.86	22.83	22.82	22.81	22.82	22.85	22.88	22.91	22.93
45		23.54	23.73	23.21	22.65	22.46	22.43	22.41	22.42	22.44	22.45	22.46	22.48	22.49	22.50
60		23.04	23.17	22.62	22.26	22.15	22.11	22.13	22.14	22.15	22.15	22.16	22.17	22.18	22.19
75		22.45	23.60	21.98	21.77	21.72	21.70	21.74	21.75	21.76	21.77	21.78	21.79	21.80	21.81
90		21.87	21.98	21.59	21.32	21.31	21.31	21.37	21.39	21.40	21.41	21.42	21.44	21.45	21.46

H(β)角度范围:-90度 - 90度
H(β)角度间隔: 0.5度
测试速度: 快速
环境温度:25.3℃
测试人员:
测试日期:2024-09-27

V(B)角度范围:-90度 - 90度
V(B)角度间隔: 0.5度
测试系统: 远方(EVERFINE)GO-2000B_V1系统 V2.0.293
环境湿度:65.0%
测试距离:6.350米 [K=1.0000]
备注:

表--2

光强分布数据表格

单位: cd

H (DEG) V (DEG)	-2.5	-2	-1.5	-1	-0.5	0	0.5	1	1.5	2	2.5	3	4	5	6
-90	23.41	23.41	23.42	23.42	23.43	23.44	23.44	23.45	23.46	23.46	23.47	23.48	23.49	23.50	23.52
-75	23.89	23.89	23.90	23.90	23.91	23.91	23.92	23.93	23.94	23.95	23.96	23.97	24.00	24.02	24.04
-60	24.49	24.49	24.50	24.50	24.51	24.51	24.52	24.53	24.54	24.55	24.56	24.57	24.59	24.61	24.63
-45	24.62	24.62	24.62	24.62	24.62	24.63	24.64	24.65	24.66	24.68	24.69	24.70	24.73	24.75	24.78
-30	24.41	24.41	24.42	24.42	24.42	24.42	24.44	24.45	24.46	24.48	24.49	24.51	24.54	24.57	24.60
-20	24.17	24.16	24.16	24.15	24.15	24.15	24.16	24.18	24.20	24.21	24.23	24.25	24.29	24.32	24.36
-15	24.00	23.98	23.97	23.97	23.96	23.95	23.97	23.99	24.01	24.03	24.05	24.07	24.11	24.16	24.20
-10	23.76	23.74	23.72	23.70	23.68	23.66	23.68	23.70	23.73	23.76	23.78	23.81	23.88	23.94	24.01
-9	23.71	23.69	23.67	23.64	23.61	23.59	23.61	23.64	23.67	23.70	23.73	23.76	23.83	23.90	23.97
-8	23.63	23.65	23.62	23.59	23.56	23.53	23.55	23.58	23.61	23.64	23.67	23.70	23.78	23.85	23.93
-7	23.55	23.60	23.58	23.54	23.50	23.46	23.48	23.51	23.54	23.58	23.61	23.65	23.73	23.81	23.89
-6	23.46	23.52	23.55	23.50	23.45	23.40	23.43	23.46	23.49	23.53	23.57	23.61	23.69	23.78	23.87
-5	23.36	23.42	23.50	23.48	23.41	23.34	23.37	23.40	23.43	23.48	23.52	23.57	23.66	23.76	23.84
-4	23.24	23.31	23.40	23.47	23.38	23.29	23.32	23.35	23.39	23.44	23.49	23.54	23.65	23.74	23.82
-3	23.14	23.19	23.26	23.39	23.37	23.25	23.27	23.31	23.37	23.42	23.48	23.54	23.64	23.74	23.83
-2.5	23.08	23.13	23.18	23.32	23.37	23.22	23.25	23.30	23.36	23.43	23.50	23.55	23.65	23.75	23.85
-2	23.03	23.07	23.13	23.23	23.39	23.20	23.23	23.30	23.38	23.45	23.52	23.57	23.68	23.78	23.87
-1.5	22.98	23.02	23.06	23.13	23.33	23.18	23.22	23.31	23.41	23.49	23.55	23.62	23.72	23.81	23.89
-1	22.92	22.96	23.00	23.05	23.19	23.15	23.24	23.38	23.47	23.56	23.63	23.68	23.77	23.85	23.92
-0.5	23.08	22.93	22.91	22.96	23.05	23.13	23.34	23.50	23.61	23.68	23.73	23.76	23.83	23.89	23.96
0	23.70	23.71	23.72	23.73	23.74	23.76	23.77	23.79	23.80	23.82	23.84	23.85	23.90	23.94	23.99
0.5	23.56	23.53	23.50	23.42	23.29	23.10	23.04	22.99	22.96	23.01	23.18	23.30	23.48	23.61	23.71
1	23.42	23.38	23.33	23.26	23.14	23.08	23.14	23.04	23.02	23.01	23.00	22.99	23.07	23.28	23.43
1.5	23.31	23.28	23.23	23.16	23.10	23.07	23.24	23.07	23.04	23.03	23.03	23.03	23.04	23.06	23.16
2	23.25	23.21	23.16	23.11	23.06	23.06	23.26	23.13	23.06	23.04	23.04	23.05	23.06	23.08	23.11
2.5	23.19	23.16	23.11	23.08	23.05	23.06	23.21	23.18	23.08	23.06	23.04	23.05	23.07	23.10	23.13
3	23.15	23.11	23.07	23.05	23.05	23.05	23.18	23.22	23.12	23.07	23.06	23.05	23.07	23.11	23.14
4	23.07	23.05	23.04	23.02	23.04	23.05	23.14	23.23	23.18	23.12	23.08	23.08	23.08	23.12	23.16
5	23.03	23.02	23.01	23.02	23.04	23.05	23.12	23.19	23.22	23.17	23.13	23.10	23.11	23.13	23.17
6	23.01	23.00	23.00	23.02	23.04	23.06	23.11	23.17	23.22	23.20	23.17	23.14	23.13	23.16	23.19
7	23.00	22.99	23.00	23.02	23.04	23.06	23.11	23.15	23.20	23.22	23.20	23.18	23.16	23.18	23.21
8	22.99	22.99	23.02	23.04	23.06	23.08	23.12	23.15	23.19	23.22	23.22	23.21	23.19	23.20	23.24
9	22.99	23.01	23.03	23.06	23.08	23.11	23.14	23.17	23.19	23.22	23.24	23.24	23.23	23.24	23.27
10	23.00	23.03	23.05	23.08	23.11	23.14	23.16	23.19	23.21	23.24	23.26	23.27	23.27	23.27	23.29
15	23.12	23.15	23.17	23.20	23.23	23.26	23.27	23.28	23.29	23.29	23.30	23.31	23.32	23.34	23.36
20	23.14	23.16	23.18	23.20	23.22	23.25	23.25	23.25	23.25	23.26	23.26	23.26	23.26	23.26	23.28
30	22.95	22.96	22.97	22.98	22.99	23.01	23.01	23.01	23.01	23.01	23.01	23.02	23.02	23.02	23.02
45	22.51	22.51	22.52	22.53	22.53	22.54	22.55	22.56	22.57	22.58	22.59	22.60	22.61	22.63	22.65
60	22.19	22.20	22.20	22.21	22.21	22.21	22.23	22.24	22.25	22.26	22.27	22.28	22.31	22.33	22.35
75	21.81	21.82	21.82	21.83	21.83	21.84	21.85	21.86	21.88	21.89	21.91	21.92	21.95	21.98	22.00
90	21.47	21.48	21.48	21.49	21.49	21.50	21.51	21.53	21.54	21.55	21.56	21.57	21.60	21.62	21.65

H(β)角度范围:-90度 - 90度
H(β)角度间隔: 0.5度
测试速度: 快速
环境温度:25.3℃
测试人员:
测试日期:2024-09-27

V(B)角度范围:-90度 - 90度
V(B)角度间隔: 0.5度
测试系统: 远方(EVERFINE)GO-2000B_V1系统 V2.0.293
环境湿度:65.0%
测试距离:6.350米 [K=1.0000]
备注:

表--3

光 强 分 布 数 据 表 格

单位: cd

H (DEG) V (DEG)	7	8	9	10	15	20	30	45	60	75	90				
-90	23.53	23.55	23.56	23.57	23.64	23.76	23.98	24.38	24.70	24.47					
-75	24.06	24.08	24.10	24.12	24.22	24.40	24.73	25.26	25.57	24.93					
-60	24.64	24.66	24.68	24.70	24.82	24.99	25.33	25.88	26.12	25.53					
-45	24.80	24.83	24.85	24.88	25.01	25.15	25.49	25.94	26.26	26.00					
-30	24.64	24.67	24.70	24.73	24.90	25.09	25.42	25.84	26.29	26.26					
-20	24.40	24.44	24.48	24.53	24.76	24.99	25.33	25.76	26.22	26.37					
-15	24.25	24.29	24.34	24.40	24.68	24.90	25.29	25.73	26.17	26.41					
-10	24.08	24.14	24.21	24.28	24.57	24.82	25.26	25.65	26.12	26.45					
-9	24.04	24.12	24.19	24.25	24.55	24.81	25.26	25.64	26.12	26.45					
-8	24.00	24.08	24.15	24.22	24.53	24.80	25.24	25.63	26.11	26.46					
-7	23.97	24.05	24.12	24.19	24.51	24.79	25.22	25.62	26.10	26.47					
-6	23.94	24.02	24.09	24.16	24.49	24.78	25.20	25.61	26.09	26.48					
-5	23.92	24.00	24.07	24.15	24.48	24.77	25.18	25.60	26.09	26.48					
-4	23.91	23.99	24.07	24.15	24.47	24.75	25.16	25.59	26.08	26.49					
-3	23.92	24.00	24.08	24.15	24.47	24.74	25.15	25.58	26.08	26.50					
-2.5	23.93	24.01	24.08	24.15	24.47	24.73	25.14	25.57	26.07	26.50					
-2	23.94	24.02	24.09	24.16	24.47	24.73	25.13	25.57	26.07	26.50					
-1.5	23.96	24.04	24.11	24.17	24.47	24.73	25.13	25.56	26.07	26.51					
-1	23.99	24.05	24.12	24.18	24.47	24.72	25.12	25.56	26.06	26.51					
-0.5	24.01	24.08	24.14	24.19	24.47	24.72	25.11	25.55	26.06	26.52					
0	24.04	24.10	24.16	24.21	24.48	24.72	25.11	25.55	26.06	26.52	24.10				
0.5	23.80	23.88	23.96	24.03	24.36	24.63	25.05	25.51	26.04	26.50					
1	23.56	23.67	23.77	23.86	24.25	24.54	24.99	25.48	26.02	26.49					
1.5	23.33	23.47	23.59	23.70	24.13	24.46	24.94	25.44	25.99	26.47					
2	23.15	23.27	23.40	23.53	24.02	24.37	24.88	25.41	25.97	26.46					
2.5	23.16	23.21	23.25	23.37	23.91	24.29	24.82	25.38	25.95	26.44					
3	23.18	23.22	23.26	23.31	23.81	24.21	24.77	25.34	25.93	26.43					
4	23.20	23.24	23.28	23.33	23.60	24.05	24.66	25.27	25.88	26.39					
5	23.21	23.26	23.30	23.35	23.59	23.89	24.55	25.21	25.84	26.36					
6	23.23	23.28	23.32	23.37	23.61	23.80	24.44	25.14	25.80	26.33					
7	23.25	23.29	23.34	23.39	23.63	23.82	24.34	25.07	25.76	26.30					
8	23.28	23.32	23.36	23.41	23.65	23.83	24.24	25.01	25.71	26.27					
9	23.30	23.34	23.39	23.43	23.67	23.85	24.15	24.94	25.67	26.24					
10	23.33	23.37	23.41	23.45	23.67	23.86	24.15	24.88	25.63	26.21					
15	23.39	23.42	23.45	23.48	23.67	23.86	24.16	24.58	25.43	26.05					
20	23.31	23.34	23.37	23.40	23.58	23.77	24.15	24.51	25.24	25.90					
30	23.02	23.04	23.08	23.11	23.29	23.49	23.89	24.40	24.92	25.57					
45	22.67	22.68	22.70	22.72	22.89	23.06	23.45	24.09	24.66	25.05					
60	22.38	22.40	22.42	22.44	22.59	22.77	23.14	23.73	24.32	24.43					
75	22.03	22.06	22.08	22.11	22.25	22.43	22.79	23.25	23.88	23.81					
90	21.67	21.70	21.72	21.75	21.87	22.04	22.38	22.89	23.43	23.31					

H(β)角度范围:-90度 - 90度
H(β)角度间隔: 0.5度
测试速度: 快速
环境温度:25.3℃
测试人员:
测试日期:2024-09-27

V(B)角度范围:-90度 - 90度
V(B)角度间隔: 0.5度
测试系统: 远方(EVERFINE)GO-2000B_V1系统 V2.0.293
环境湿度:65.0%
测试距离:6.350米 [K=1.0000]
备注: